


# SBI test (EN 13823)

SP  
Fire Technology

Productname: **Test c1**




Processing: 19 april 2007  
Test report: X

Preliminary SBI classification: **C / s1 / d0**  
(Final classification assessment is based on repetitive SBI tests and other tests)

## Classification parameter results:

FIGRA <sub>0,2MJ</sub> [W/s]:	185.0	LFS till edge {Y/N}:	N
FIGRA <sub>0,4MJ</sub> [W/s]:	185.0	FDP(f<=10s) {Y/N}:	N
THR <sub>600s</sub> [MJ]:	12.6	FDP(f>10s) {Y/N}:	N
SMOGRA [m <sup>2</sup> /s <sup>2</sup> ]:	1.7	FSG rec 22	
TSP <sub>600s</sub> [m <sup>2</sup> ]:	28.8	Checks OK {Y/N}:	Y
TSP <sub>600s</sub> [m <sup>2</sup> ]:	35.0		

HRR<sub>av</sub>(t) and THR(t)

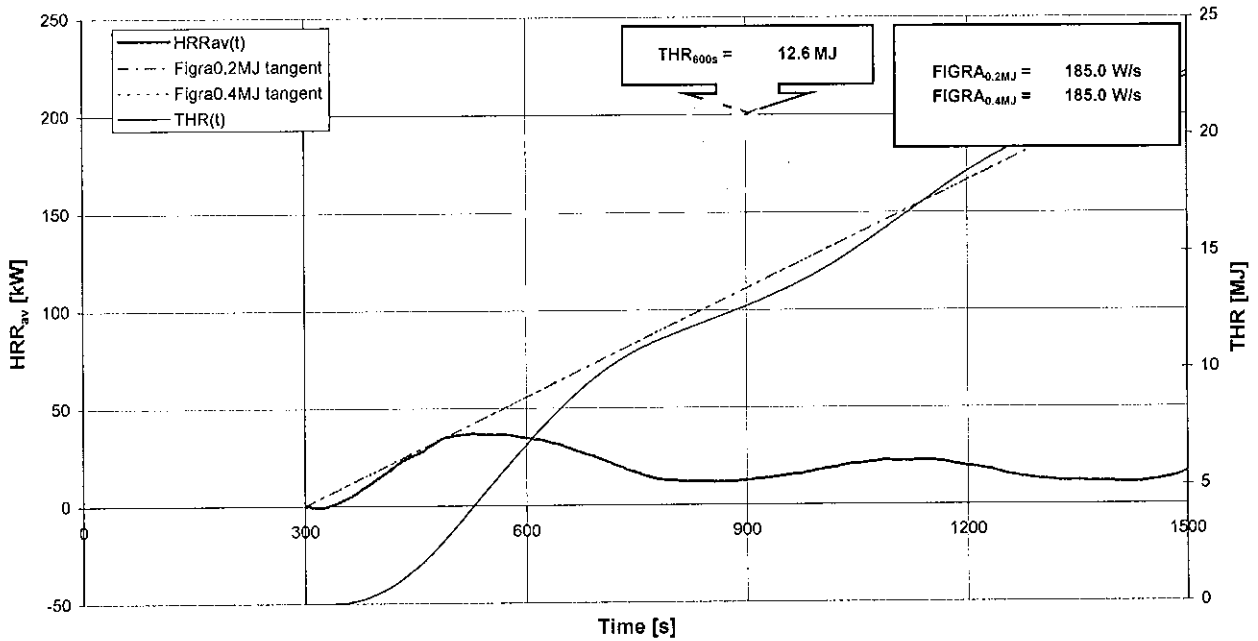

SPR<sub>av</sub>(t) and TSP(t)

